


## Clearance envelope for grain bins filled by permanently installed augers, conveyors or elevators

- P** = Probe clearance  
5.5m (18 ft) required by Rule 234F1a
- H** = Horizontal clearance  
4.6m (15 ft) required by Rule 234F1b
- T** = Transition clearance


- V<sub>1</sub>** = Vertical clearance above a building required by Rule 234C
- V<sub>2</sub>** = Vertical clearance required by Rule 232B

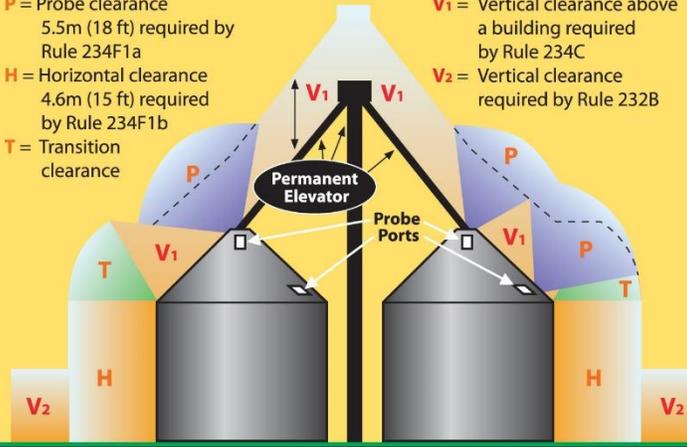

From IEEE Std. C2-2017, "National Electrical Safety Code." © Copyright 2016 by IEEE. All rights reserved.

## Clearance envelope for grain bins filled by portable augers, conveyors or elevators

### ELEVATION

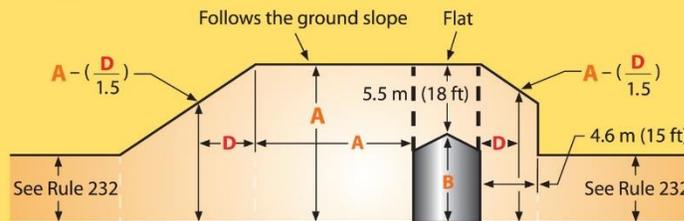


- B** = Height of highest filling or probing port on grain bin
- A** = B + 5.5m (18 ft)
- D** = Variable horizontal dimension

In the area of sloped clearance, the vertical clearance is reduced by 300mm (1 ft) for each additional 450mm (1.5 ft) of horizontal distance from the grain bin.

### PLAN VIEW

#### LOADING SIDE

See Rule 232  
Area of sloped clearance

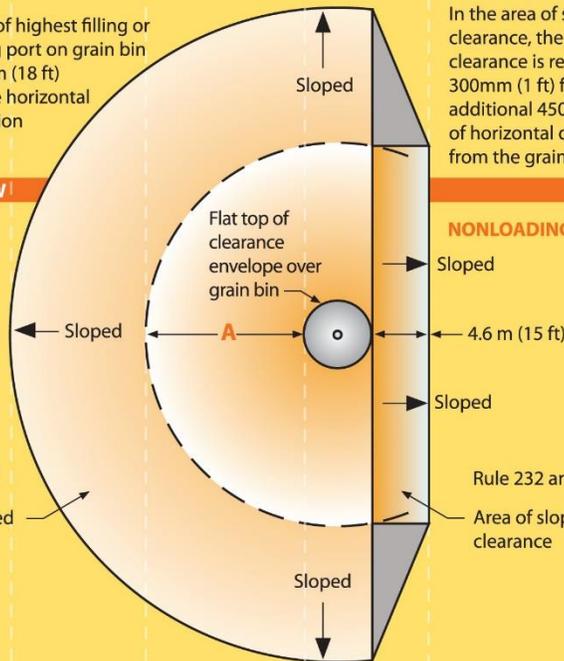

#### NONLOADING SIDE

Rule 232 area  
Area of sloped clearance

From IEEE Std. C2-2017, "National Electrical Safety Code." © Copyright 2016 by IEEE. All rights reserved. The IEEE disclaims any responsibility or liability resulting from the placement and use in the described manner.

**Disclaimer:** These drawings are provided as part of Iowa electric cooperatives' annual public information campaign and are based on the 2017 Edition of the National Electrical Safety Code. To view the actual drawings, refer to that publication. Every care has been taken for the correctness of the contents for these drawings. However, the Iowa Association of Electric Cooperatives and its member cooperatives accept no liability whatsoever for omissions or errors, technical inaccuracies, typographical mistakes, or damages of any kind arising from the use of the contents of these drawings, whether textual or graphical.